



Contents

Summary of general arrangements 3

Assembly Point..... 4

Ground floor..... 5


Floor 1 6

Floor 2 7

Summary of general arrangements


Alarm tests:	<ul style="list-style-type: none">• The fire alarm audibility test is undertaken on Thursdays.• The test will last for no more than 15 seconds.• If an alarm sounds for more than 15 seconds or on any other day, you must evacuate.
Refuge Intercoms	<ul style="list-style-type: none">• Located in / adjacent to the protected stairwells on all floors above ground level.
Final exits with level access	<ul style="list-style-type: none">• The main entrance has level / ramped access / egress.• The emergency exit opposite Campus Central also has level / ramped access / egress.• All other exit routes have external steps.
Lifts 	<ul style="list-style-type: none">• The lift cannot be used in the event of the fire alarm being activated.• An evacuation chair can be requested from Security by using the Refuge Intercoms.

Assembly Point

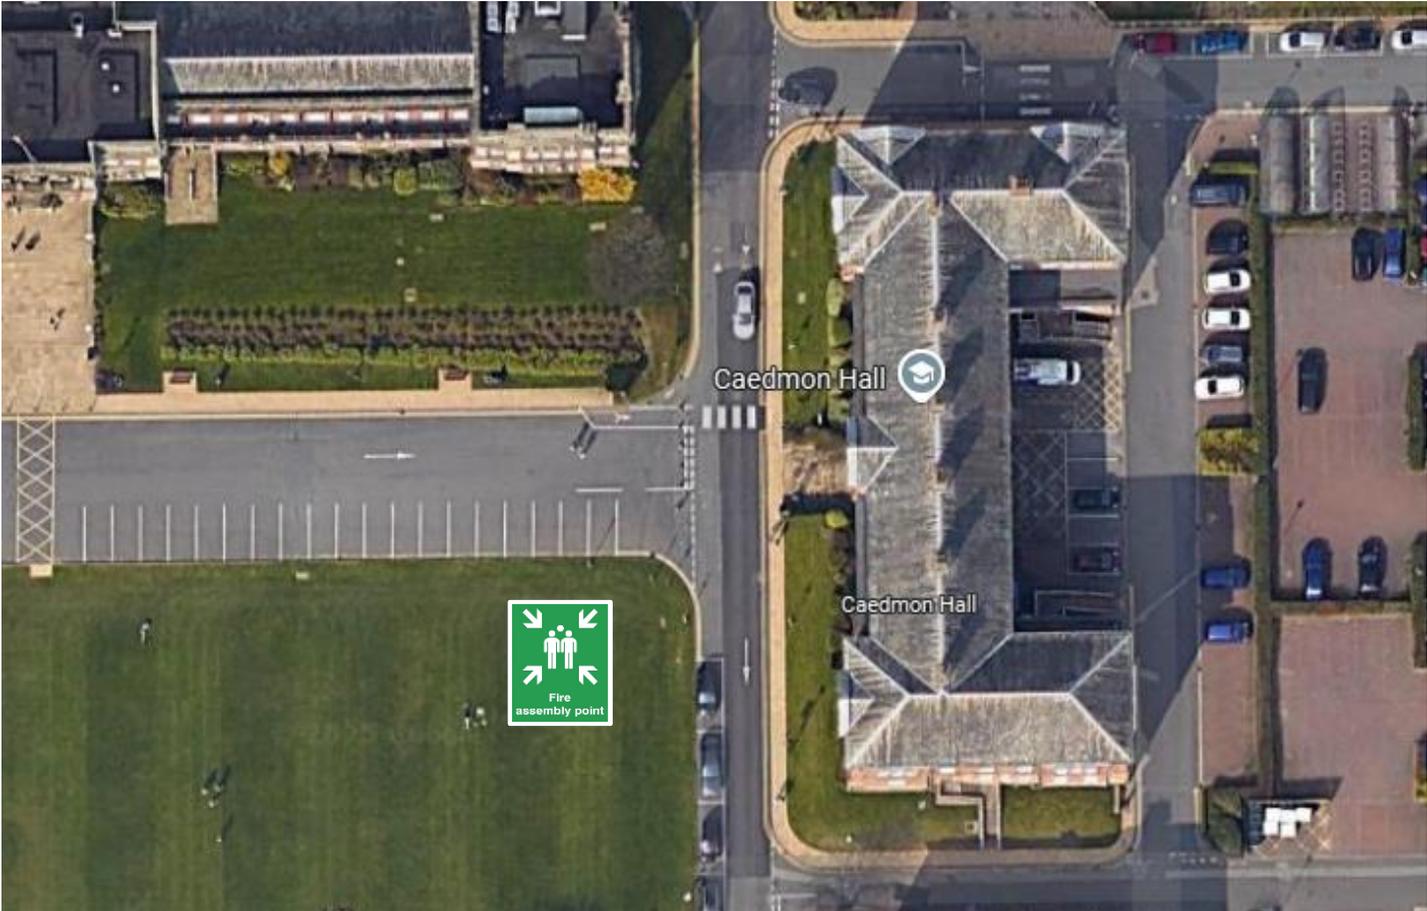

Assembly point


Ground floor

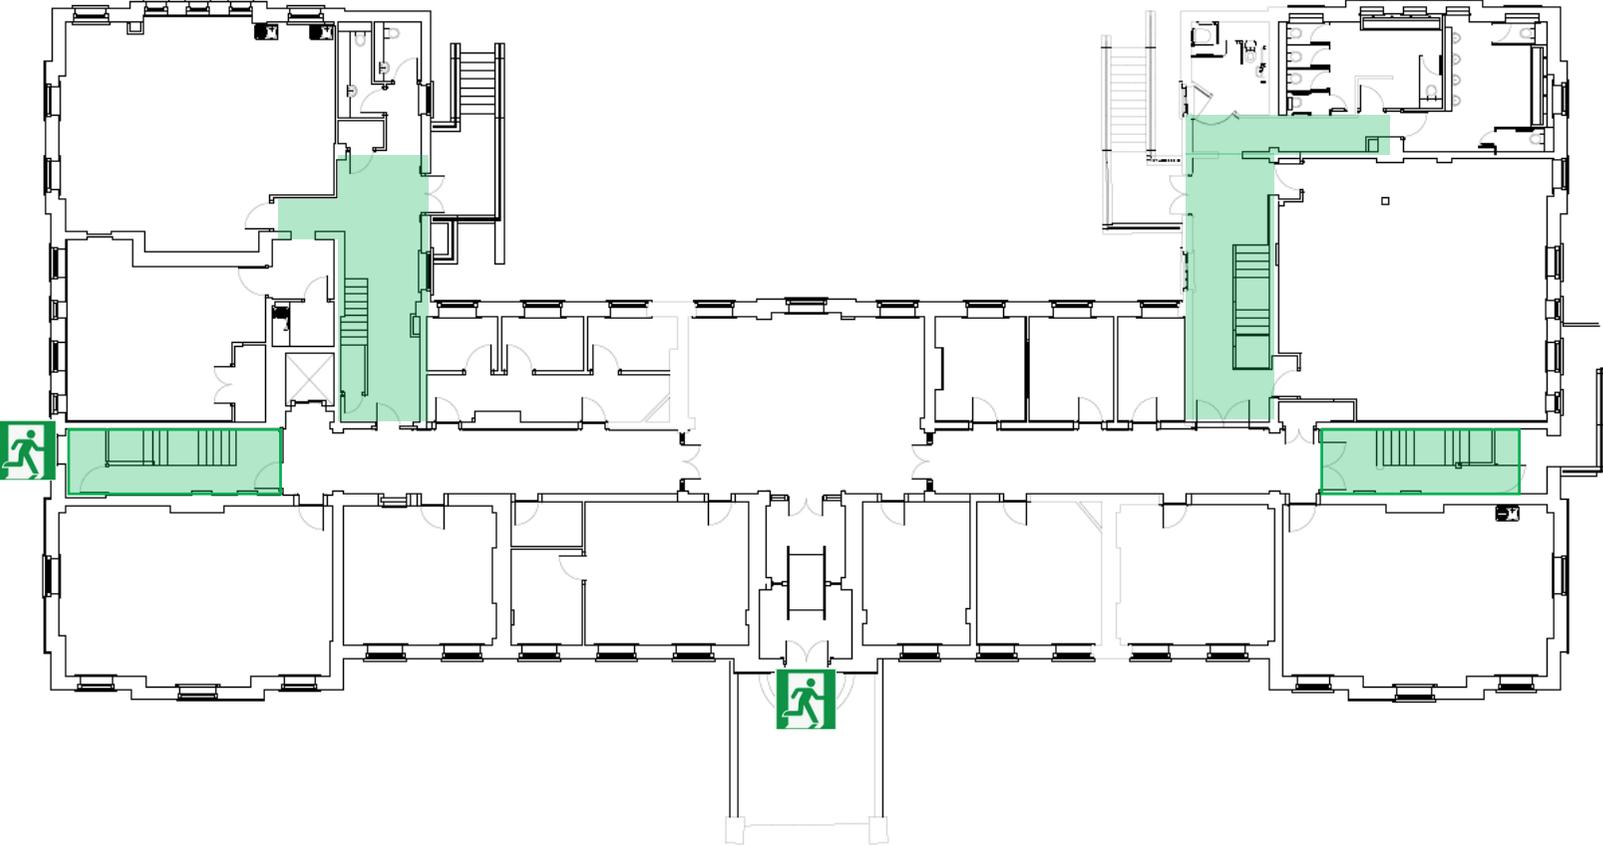

 Level access Fire Exit

 Protected Stairwell


Floor 1

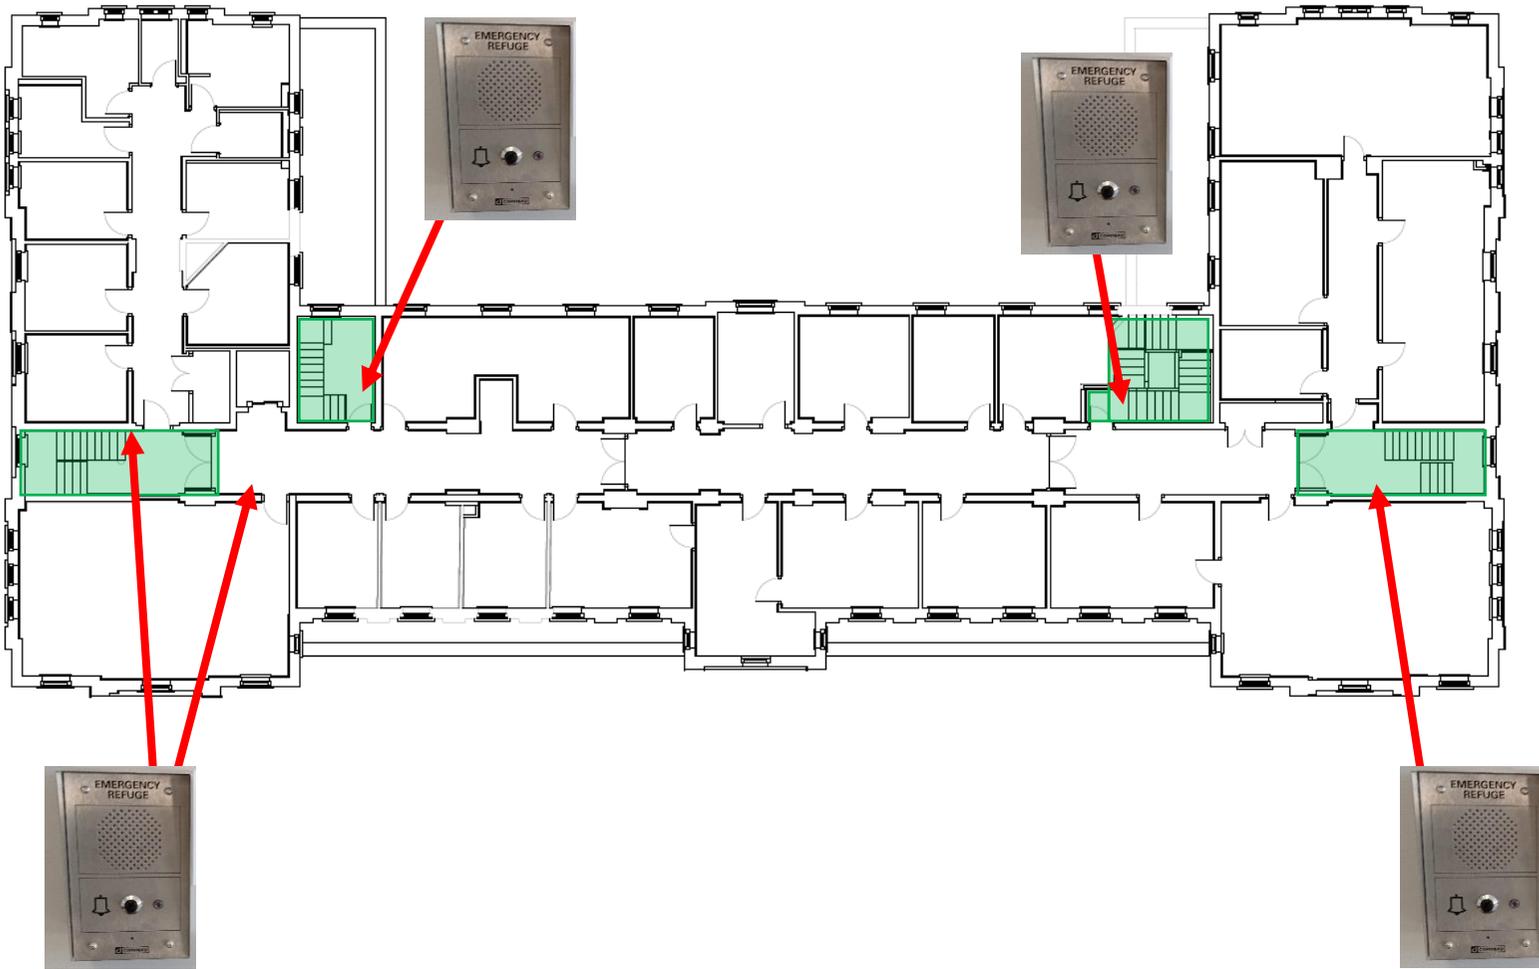

Refuge Intercom points:



Floor 2

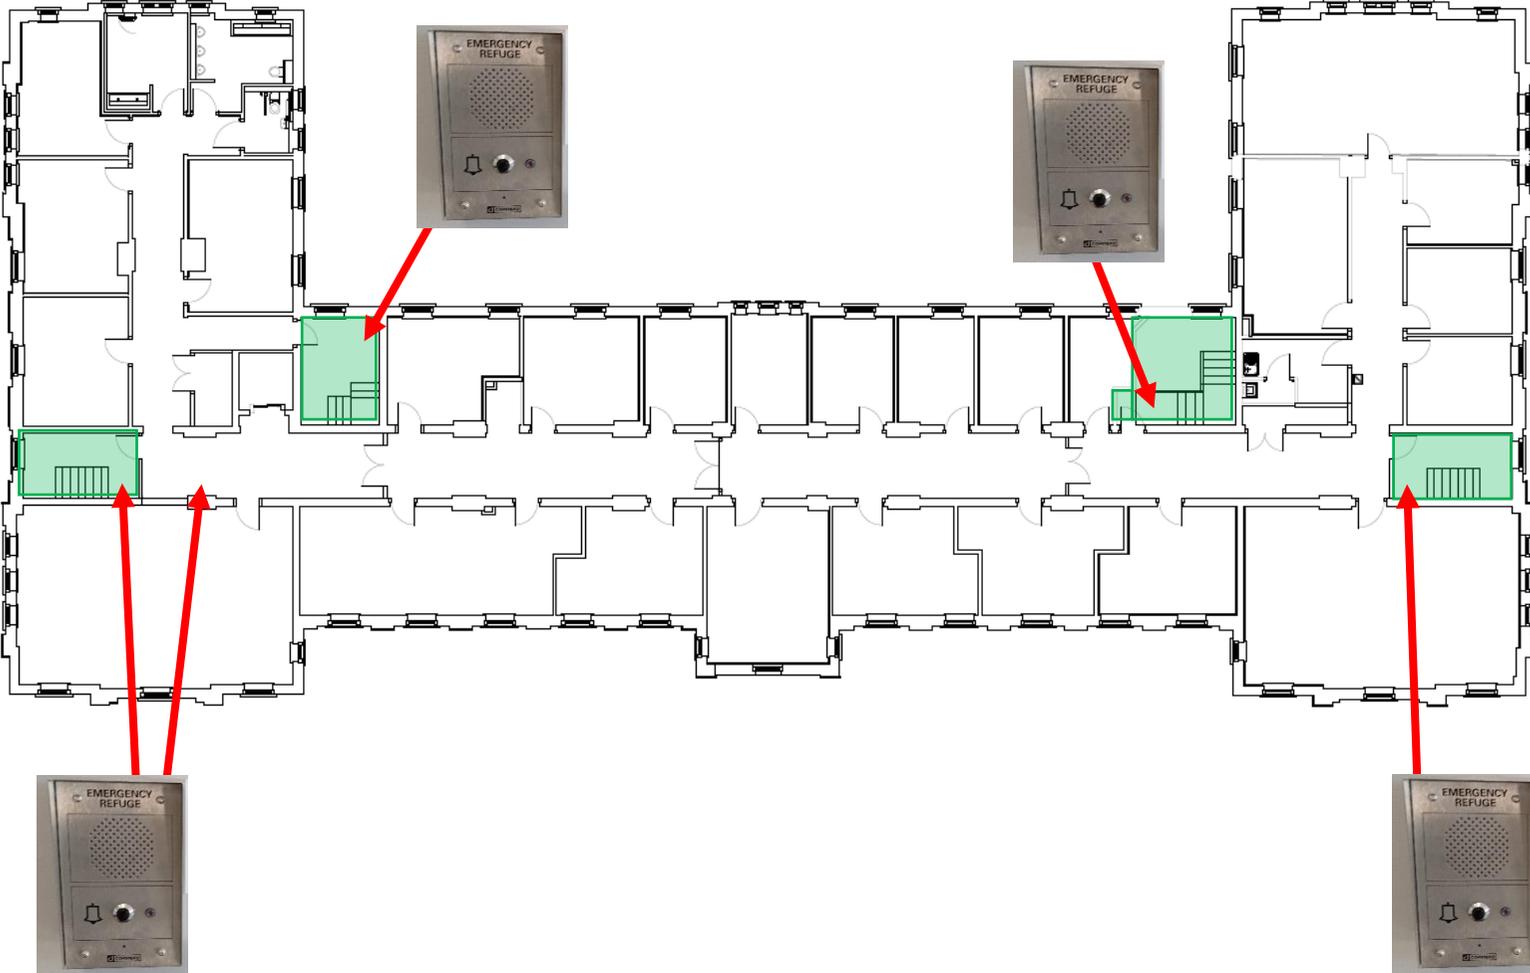

Refuge Intercom points:

