



Contents

Summary of general arrangements 3

Assembly Point..... 4

Ground floor..... 5

Floor 1 6

Floor 2 7

Summary of general arrangements


Alarm tests:	<ul style="list-style-type: none">• The fire alarm audibility test is undertaken on Thursdays.• The test will last for no more than 15 seconds.• If an alarm sounds for more than 15 seconds or on any other day, you must evacuate.
Refuge Points	<ul style="list-style-type: none">• The four stairwells are all protected stairs, and the landings can be used as a temporary refuge that is safe from smoke and flame ingress for at least 30 minutes when the fire doors are closed.• Communication with the evacuation management team can be made by phoning the University's Security Emergency number on 0113 812 4444.
Final exits with level access	<ul style="list-style-type: none">• The two exits nearest to Priestley Hall have level means of egress.• All other exit routes have flights of external steps.
Lifts 	<ul style="list-style-type: none">• The lift cannot be used in the event of the fire alarm being activated.• An evacuation chair can be requested from Security by calling 0113 812 4444.

Assembly Point



Assembly point

Ground floor

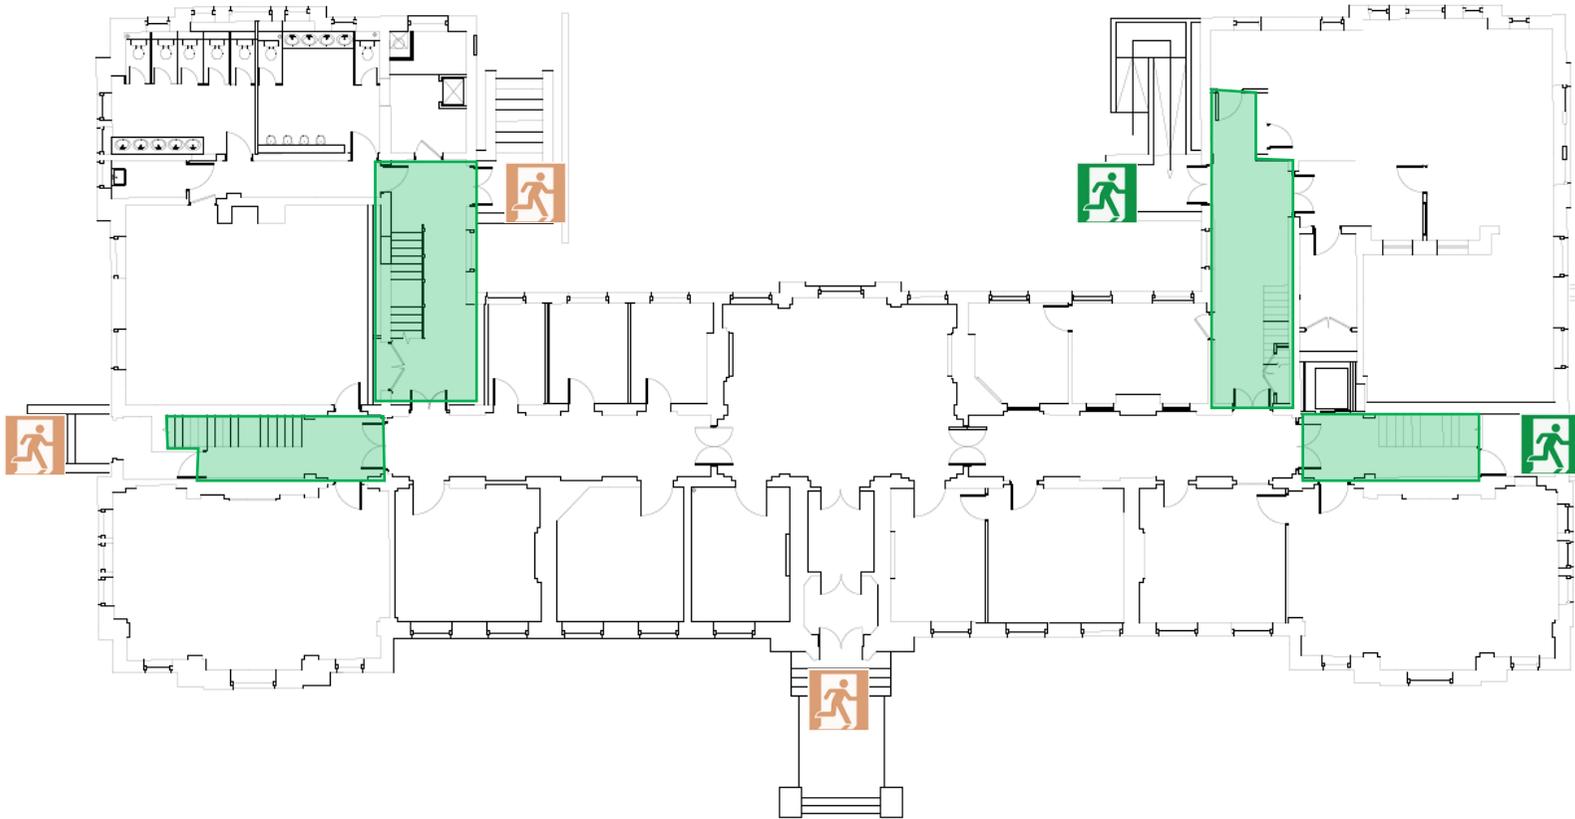


 Level access Fire Exit

 Alternative exit but with some external steps

 Protected Stairwell


Floor 1

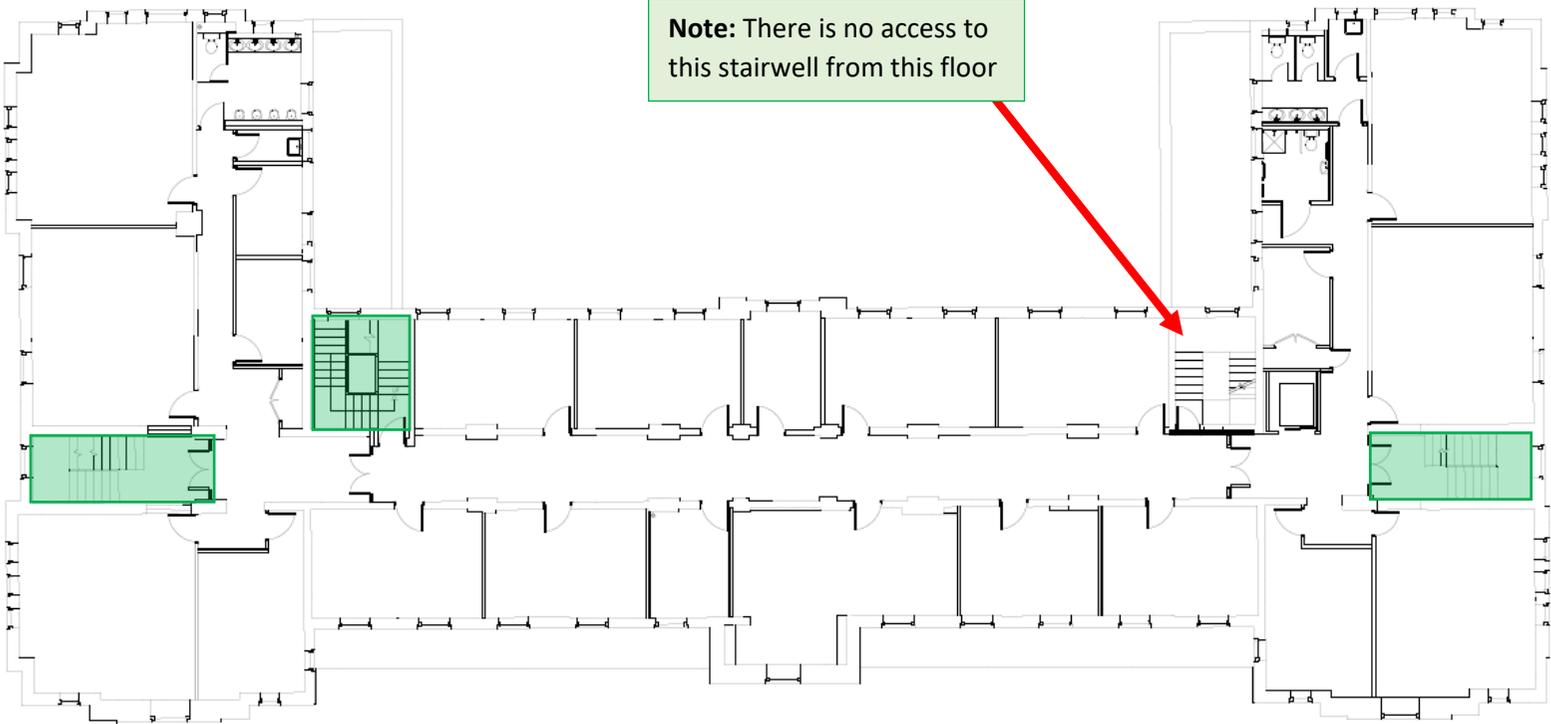

Note: There is no access to this stairwell from this floor

Protected Stairwell

Floor 2

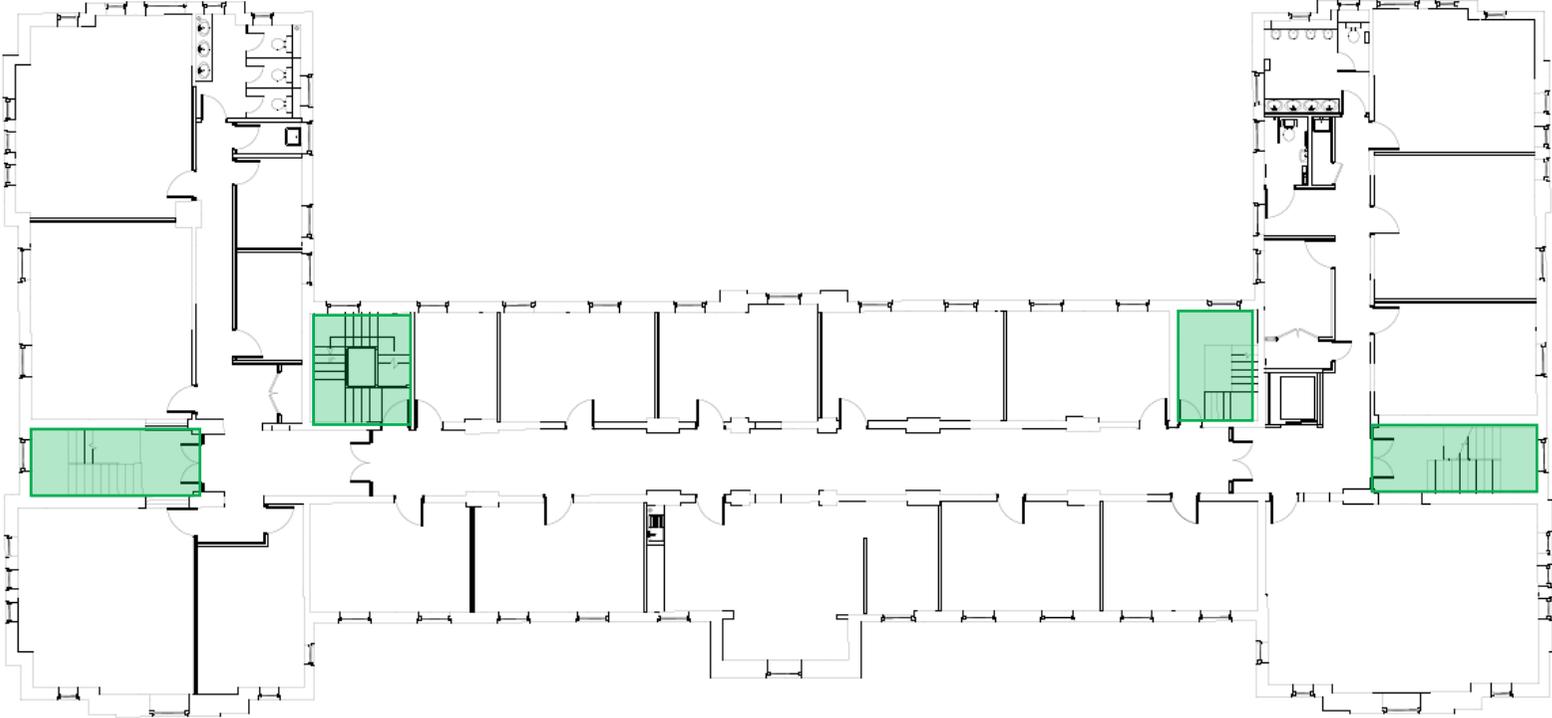

 Protected Stairwell