



Contents

Summary of general arrangements 3

Assembly Points 4

Basement 5

Ground floor..... 6


Floor 1 7

Floor 2 8

Summary of general arrangements

Alarm tests:	<ul style="list-style-type: none">• The fire alarm audibility test is undertaken on Thursdays.• The test will last for no more than 15 seconds.• If an alarm sounds for more than 15 seconds or on any other day, you must evacuate.
Refuge Points	<ul style="list-style-type: none">• The stairwells that are shaded green on the plans below are all protected stairs, and the landings can be used as a temporary refuge that is safe from smoke and flame ingress for at least 30 minutes when the fire doors are closed.• Communication with the evacuation management team can be made by phoning the University's Security Emergency number on 0113 812 4444.
Final exits with level access	<ul style="list-style-type: none">• The main entrance has level / ramped access / egress.• The escape routes that exit onto Queen Square have external steps.• The escape routes that exit onto Queen Square Court and from the ground floor workshop have level access / egress.
Lifts 	<ul style="list-style-type: none">• The lift cannot be used in the event of the fire alarm being activated.• An evacuation chair can be requested from Security by calling 0113 812 4444.


Assembly Points

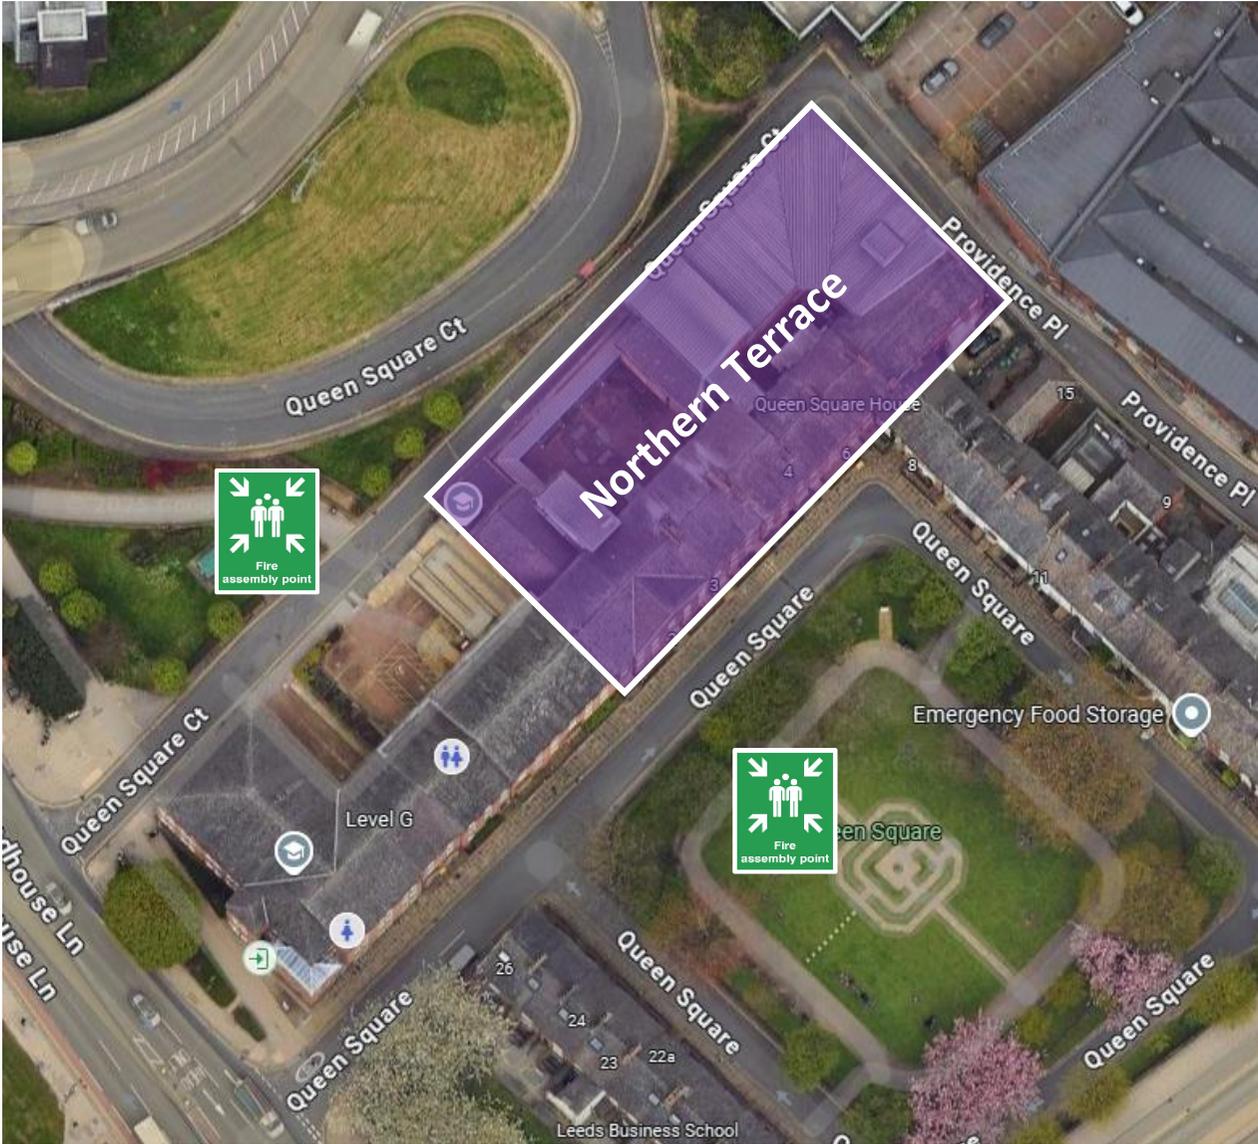

Assembly point

Basement

(Queen Square Court)

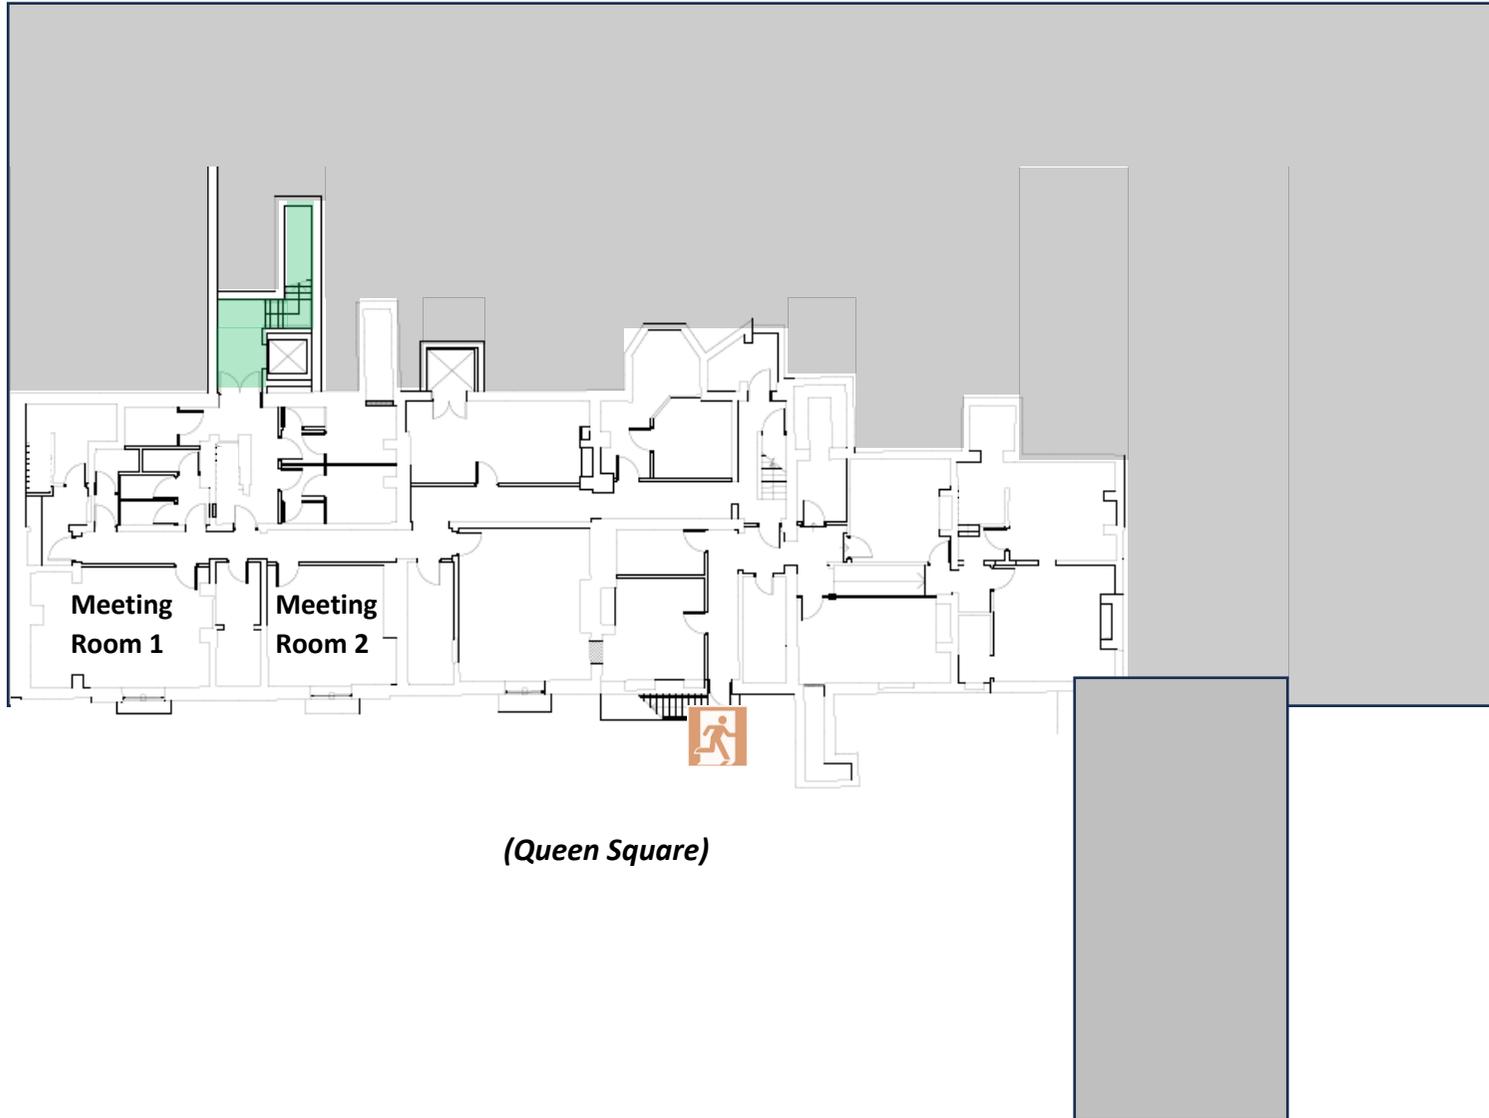


 Exit but with some external steps

 Protected Stairwell

(Providence Place)

(Queen Square)

Ground floor

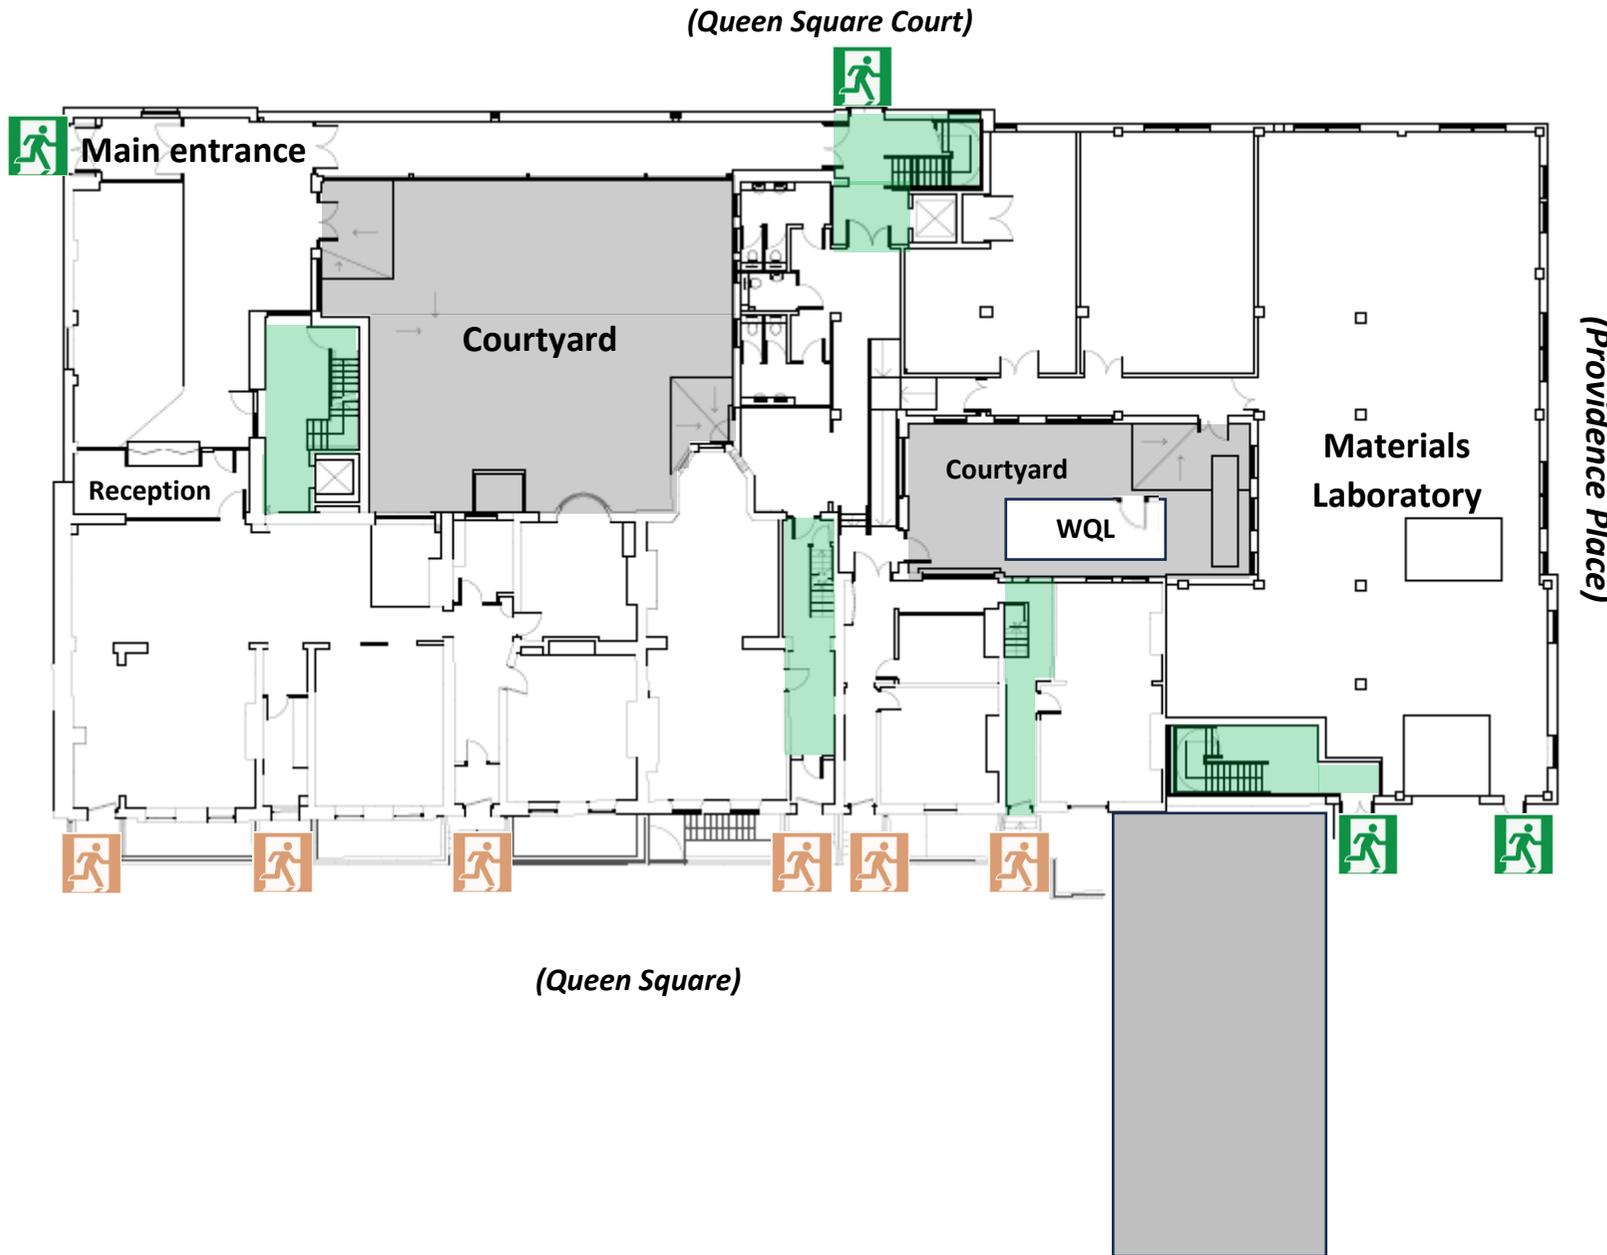

-  Level access Fire Exit
-  Alternative exit but with some external steps
-  Protected Stairwell

Floor 1

(Queen Square Court)



 Protected Stairwell

(Providence Place)

(Queen Square)

Floor 2

(Queen Square Court)

Protected Stairwell



(Providence Place)

(Queen Square)